


24kV Metal-Enclosed
SF₆ Gas Insulated Switchgear

MEIDEN
Quality connecting the next

HICLAD 20GC



24kV



Compact, reliable, and economic for medium-voltage applications



Design Concept


This switchgear conforms to IEC62271-200, and all primary components employed therein are in accordance with the relevant IEC standards.
It is designed to accommodate high-performance vacuum circuit-breaker(VCB), which has been designed and tested in accordance with IEC62271-100.
SF₆ gas insulation used in conjunction with VCB has resulted in switchgear setting new standards with respect to;



- Operation reliability
- Reduced maintenance work
- Safety for persons
- Free from environmental pollution
- Reduced dimensions and less space requirements
- Current interruption by VCB with zero SF₆ gas pressure (equal to atmospheric pressure)

Features

- **Safety**
No exposure of high-voltage live part to the air.
Complete interlocking system against erroneous operation.
Equipment of manual operation mechanism in an emergency.
- **User-friendly**
Visualized operation mechanisms equipped with mimic bus and symbols.
VCB can be operated from remote.
Compact size achieved by optimal arrangement of devices.
- **Imperious to environment**
High-voltage live part is completely protected against moisture and dust.
- **Reliability**
Reliable plug-in busbar system.
Keeping the ability of breaking circuit, even if the insulating gas pressure becomes zero.
Enhancement of reliability by reduction in number of parts achieved by simple structure.
- **Adaptability**
No gas handling work is required during site installation.
Adaptable for various requirements of network by employing plug-in type voltage transformer and lightning arrester.
Insulating performance is imperious to the installation altitude.
Test of high-voltage part can be fully performed without any gas handling.
- **Economical Efficiency**
Easy maintenance.
No maintenance is needed for high-voltage equipment in the gas compartment.
SF₆ gas is not polluted by arc because of employing VCB.
(SF₆ gas is used only as insulation medium.)

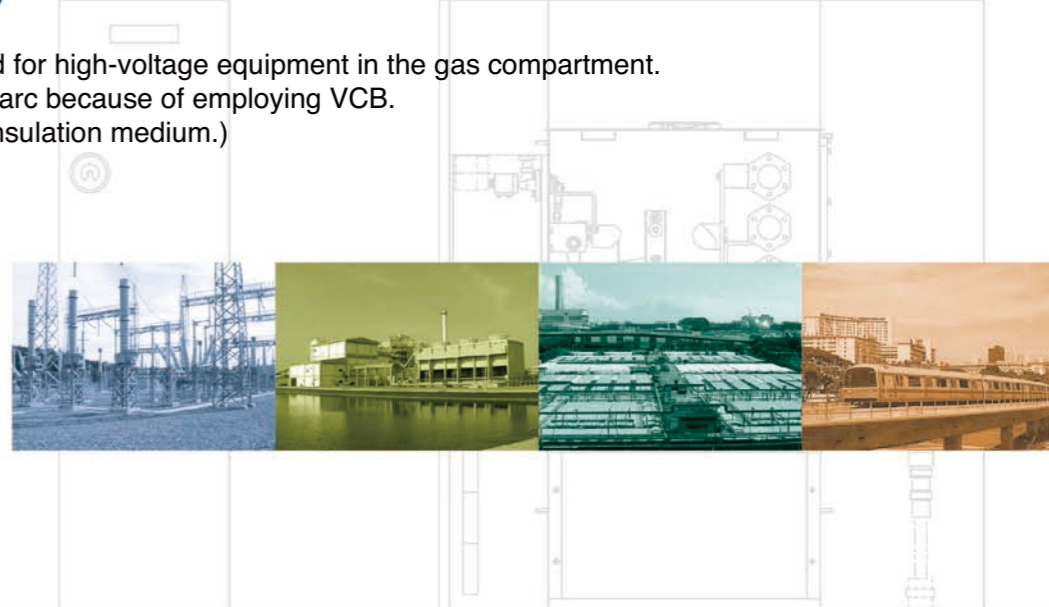

24kV

Technical Specification

Technical data


Table 1 Switchgear

Switchgear model	HICLAD 20GC		
Switchgear type	BGC-24		
Applicable standards	IEC62271-200		
Classification of switchgear	SF6-insulated metal-enclosed		
Service condition	<ul style="list-style-type: none"> Altitude < 1000m 	<ul style="list-style-type: none"> Ambient temperature Max. 40°C, Min. -5°C 24h. average < 35°C 	<ul style="list-style-type: none"> Relative humidity 24h.average < 95% 1 month average < 90%
Rated voltage (kV)	24		
Rated current (A)	1250		
Rated frequency (Hz)	50/60		
Insulation level	1 min power frequency (kV rms)	50	
	1.2 × 50 μs impulse (kV peak)	125	
Rated short-time withstand current (kA-s)	25-3		
Degree of protection	HV compartment	IP65	
	LV compartment	IP40	
Gas pressure	Rated pressure (MPa)	0.05	
	Alarm pressure (MPa)	0.02	
Operation of 3-position isolator	Manual		
Auxiliary voltage	Control circuit (V)	DC 30, 110, 125	
	Motor circuit (V)	AC 220, 230, 240 / DC 110, 125	


Table 2 Vacuum Circuit-Breaker (VCB)

VCB model	VGC-22	
Applicable standards	IEC62271-100	
Rated voltage (kV)	24	
Rated current (A)	1250	
Rated frequency (Hz)	50/60	
Insulation level	1 min power frequency (kV rms)	50
	1.2 × 50 μs impulse (kV peak)	125
Rated short-circuit breaking current (kA)	25	
Rated short-circuit making current (kA peak)	63	
Rated short-time withstand current (kA-s)	25-3	
Operating duty	0-0.3sec-CO-3min-CO	
Rated closing time (s)	0.05	
Rated opening time (s)	0.05	
Rated break time (s)	0.07	
Rated TRV for terminal fault	Rate of rise (kV/μs)	0.47
	TRV peak voltage (kV)	41
Type of operating mechanism	Motor charged spring	

Construction

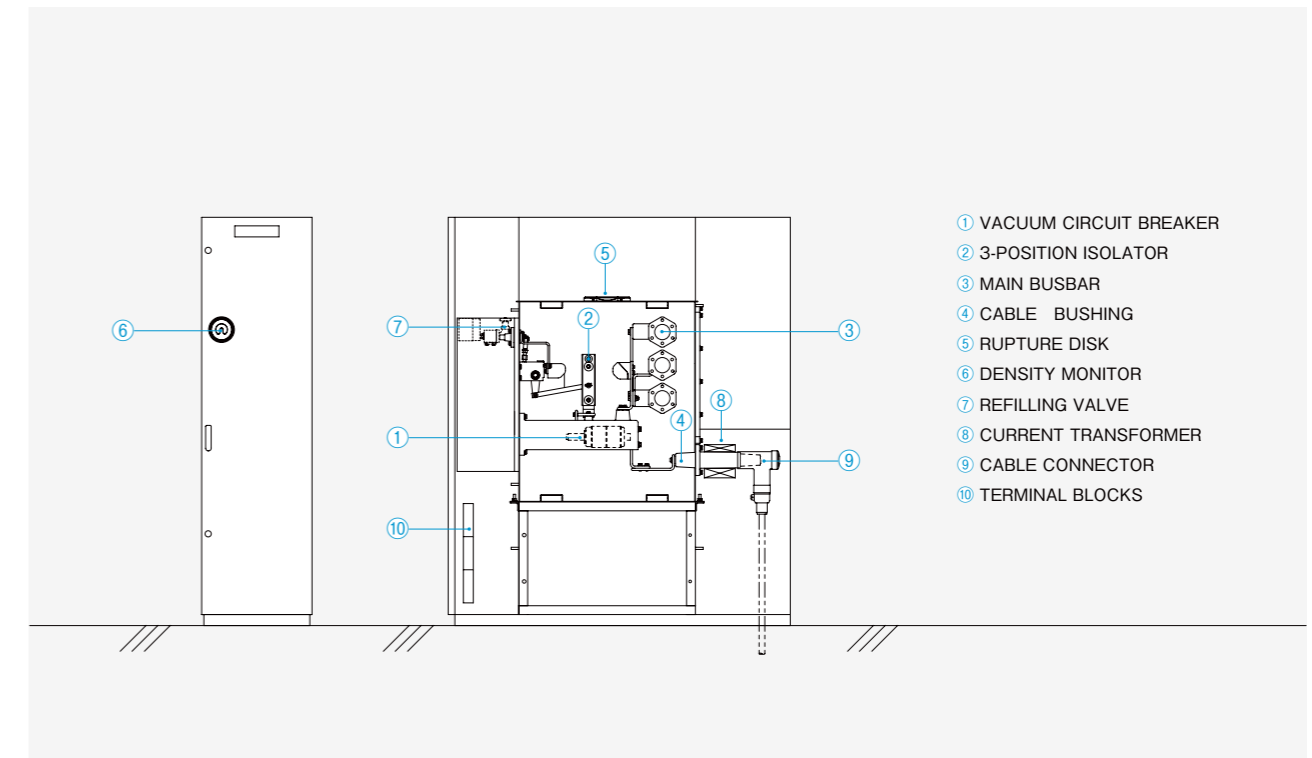


Gas monitoring system

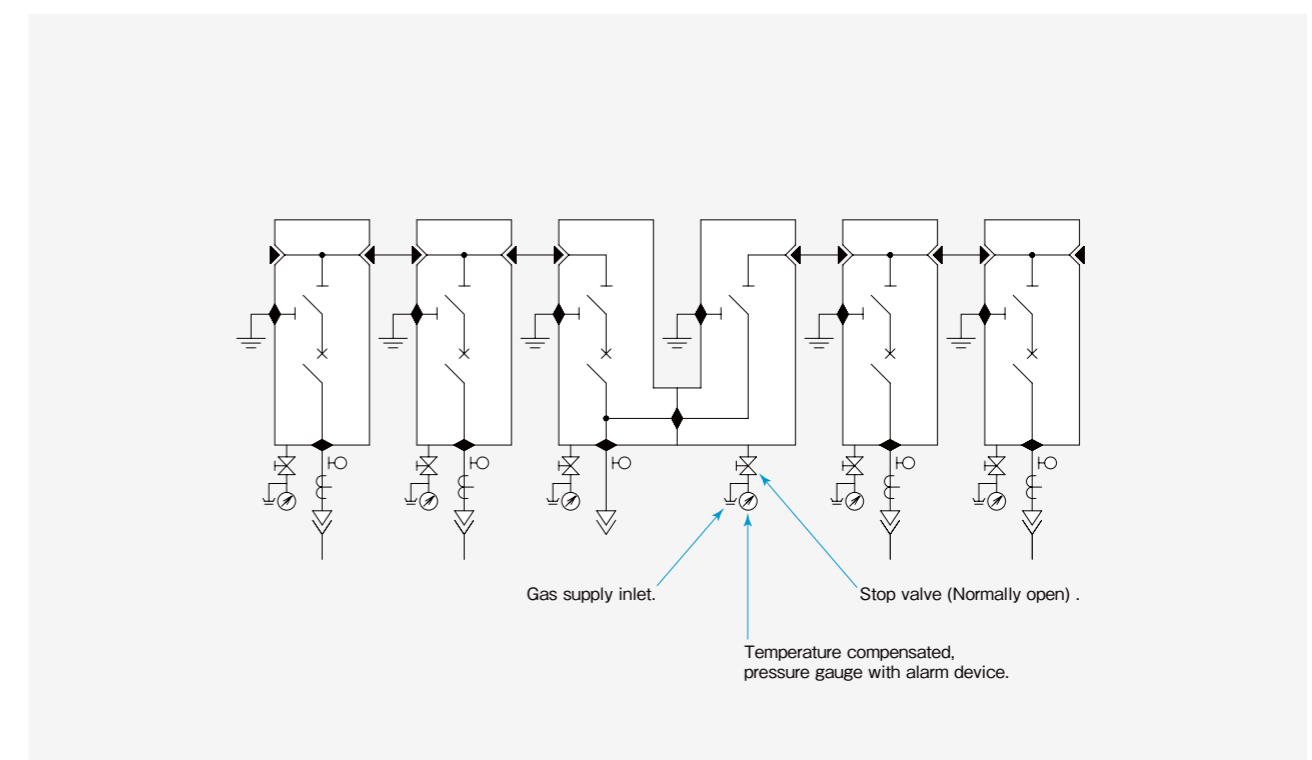


Basic Pattern


Feeder panel

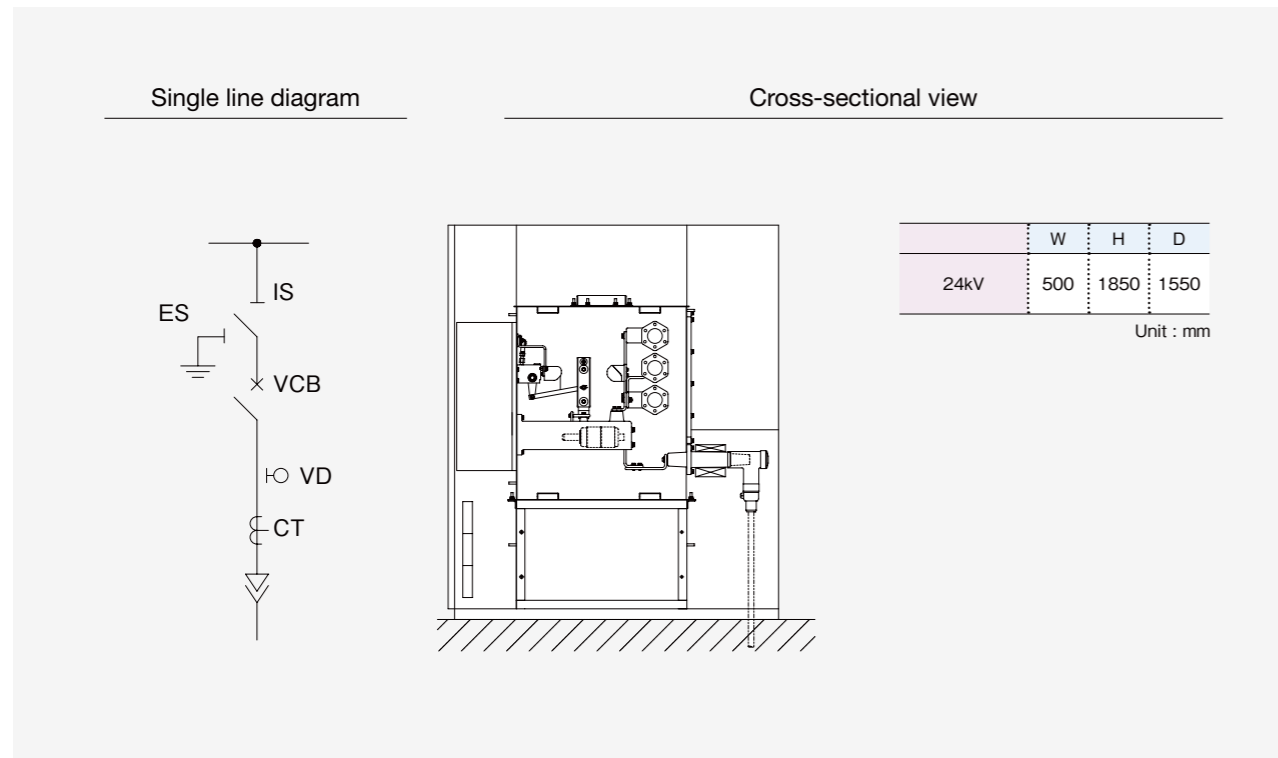


Bus section panel

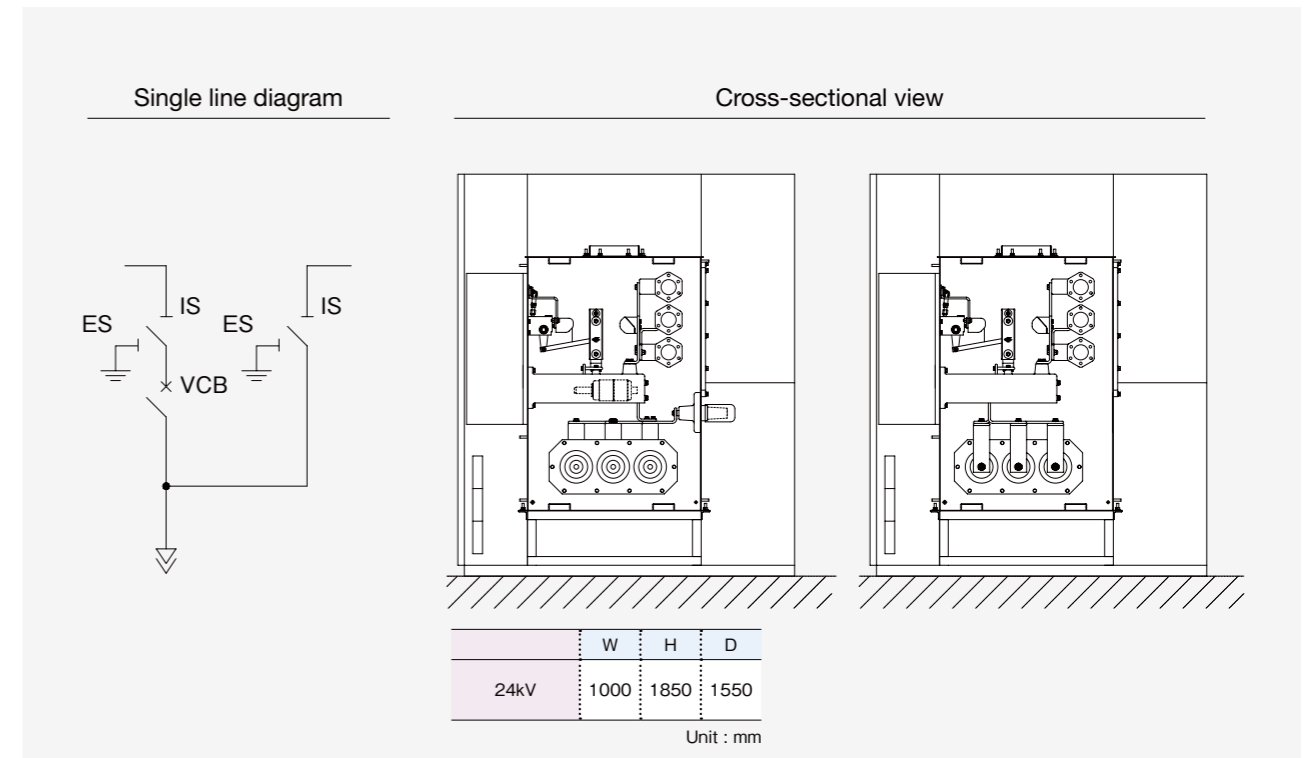

Feeder panel with VT

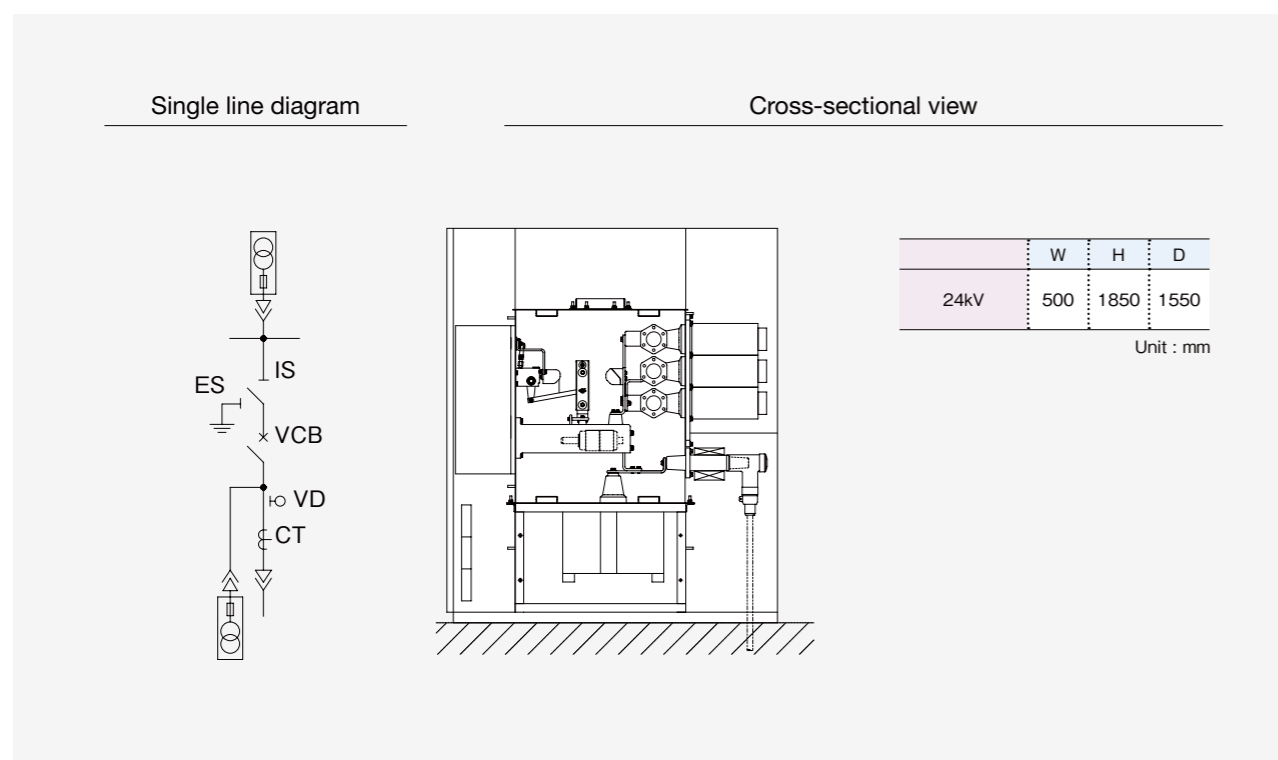

Bus section panel with CT & Bus VT

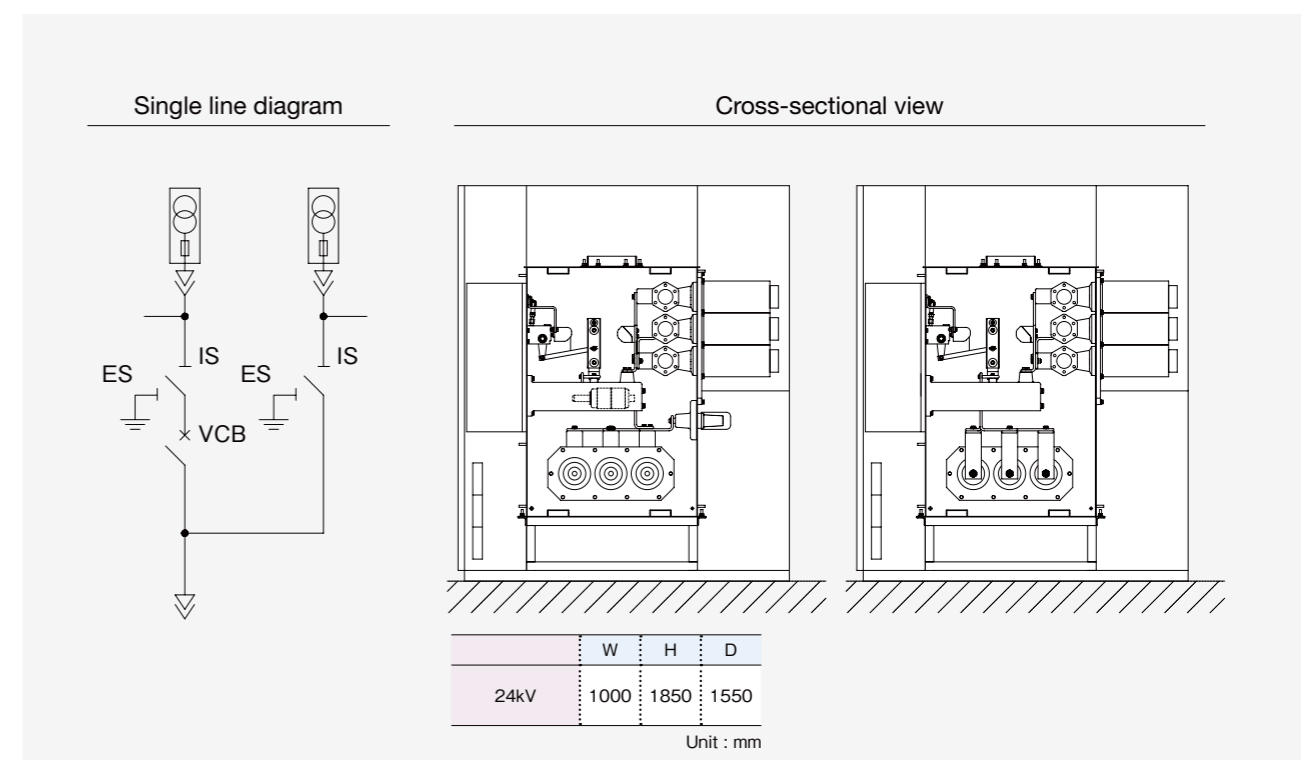

Note: Dimensions and components may be changed according to the specifications.

Note: Dimensions and components may be changed according to the specifications.

Installation

The individual switchgear, which has been assembled, wired up and tested in factory are delivered to site. Site works for installation require only the setting of the switchgear in the position, connections of inter-panel joints of busbars and cabling of both power and control cables. The typical maintenance space, dimensions of cable pit and foundation are shown in Fig.2 and Fig.4 respectively.

Fig.1 Single line diagram

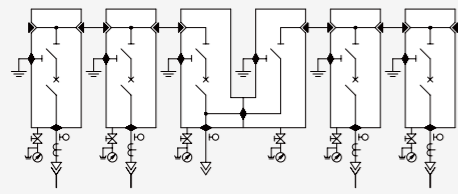


Fig.2 Maintenance Space

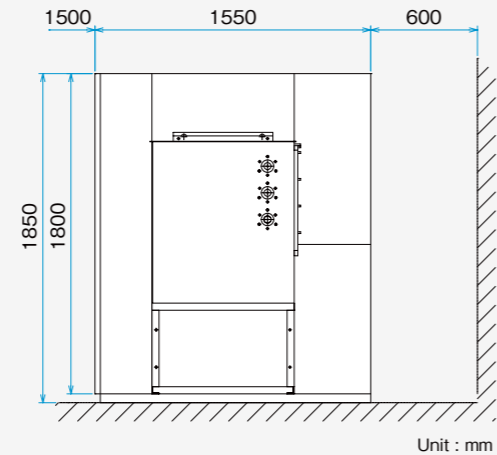


Fig.3 Switchgear Alignment


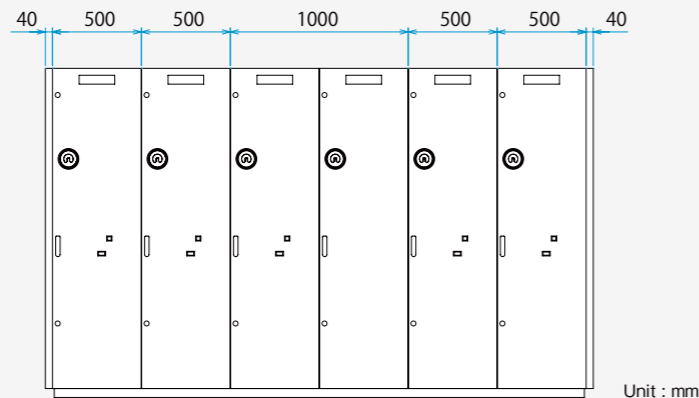


Fig.4 Foundation

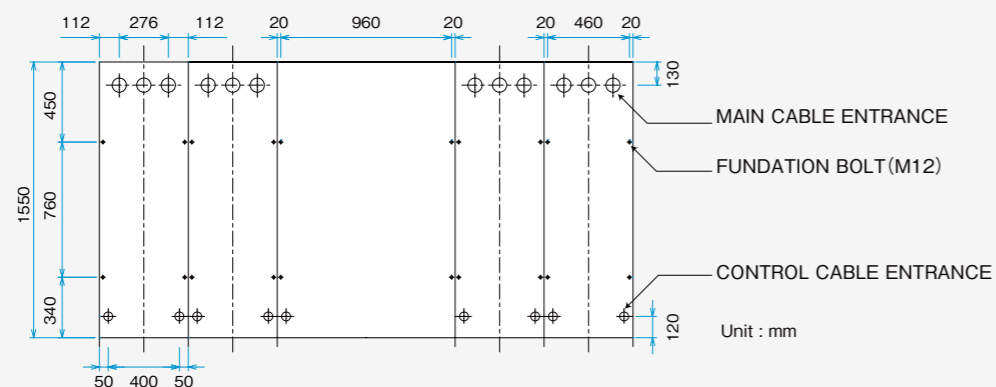

Note: The opening size of cable pit and the location of foundation bolt should be confirmed on each project.

Cable Termination and Testing


BGC-24 employs high reliable cable termination system, which is of pre-molded plug-in type for various types of 24kV power cables.

The cable plug can be equipped with capacitive voltage divider to connect with the neon voltage indication lamps for continuous voltage monitoring of main circuit. And also it allows phase sequence check by portable phase comparator after connection of cables. In addition, high voltage test plug is available to perform both primary injection test for CTs and high voltage test for cables connected to switchgear.

Typical arrangement of cable termination system and high voltage test plug are shown in Fig.5. The following tools / accessories are optionally available to the cable termination system.


1. High voltage test plug for primary injection test and high voltage test
2. Protection cap for protecting withdrawn cable connectors against damage and dirt
3. Blind cap for protection against electric-shock hazard for live cable connector
4. Sealing end for sealing and voltage-proof closing of plug-in socket
5. Phase comparator for phase sequence check
6. Earthing adapter for earthing and short-circuit of cable circuit of switchgear

Fig.5 HV Test Plug

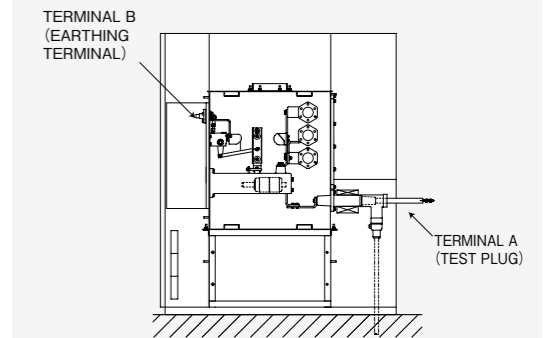

The earthing of main busbar and line side shall be performed as shown as in Fig.6.

Fig.6 Earthing

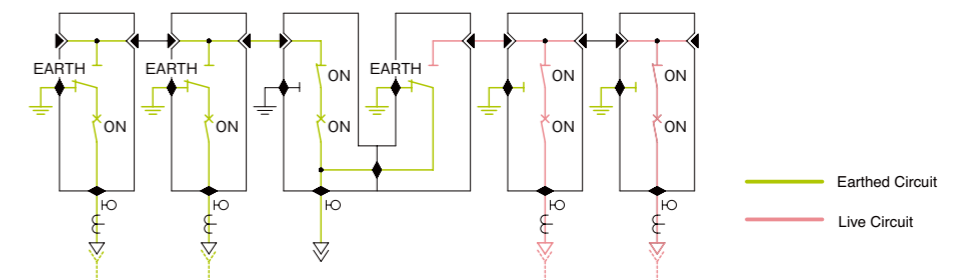

Ancillary Equipment

BGC-24 provides the following ancillary equipment.

1. Mechanical indicators

- a. Operating counter of circuit breaker
- b. Spring of CB "Charged-Discharged"
- c. Circuit breaker "ON"
- d. Circuit breaker "OFF"
- e. 3-position isolator "ON"
- f. 3-position isolator "OFF"
- g. 3-position isolator "Ready to Earth"

2. Padlocking facilities (Option)

- a. Front door of LV compartment
- b. Manual "ON" and "OFF" push button switches of circuit breaker
- c. Inlet for manual operating handle of 3-position isolator



MEIDENSHA CORPORATION

ThinkPark Tower, 2-1-1, Osaki, Shinagawa-ku, Tokyo, 141-6029 Japan

www.meidensha.com

Overseas Offices & Group Companies

China

MEIDEN ZHENGZHOU ELECTRIC CO., LTD.

No.87 Hehuan Street, Zhengzhou Hi-Tech Industries Development Zone, Zhengzhou, Henan Province, P.C. 450001, P.R.China
Phone: 86-371-56971963 Facsimile: 86-371-56971981

MEIDENSHA (SHANGHAI) CORPORATE MANAGEMENT CO., LTD.

17A, Global Harbor Office Tower B, No.1188 Kai Xuan North Road, Putuo District, Shanghai 200063, P.R. China
Phone: 86-21-5306-2200 Facsimile: 86-21-6386-0058

MEIDEN HANGZHOU DRIVE SYSTEMS CO., LTD.

No.168, Hongxing Road, Qiaonan District, Xiaoshan Economic & Technological Development Zone, Hangzhou, Zhejiang, P.C. 311231, P.R.China
Phone: 86-571-8369-6808 Facsimile: 86-571-8369-6818

SHANGHAI MEIDENSHA CHANGCHENG SWITCHGEAR CO., LTD.

No. 885, Xingrong RD Industrial Zone, Jiading, Shanghai, P.C. 201807, P.R.China
Phone: 86-21-69169911 Facsimile: 86-21-69169922

Hong Kong

MEIDEN PACIFIC (CHINA) LTD.

Unit 01-02A, 16/F, Tower 1, Ever Gain Plaza, 88 Container Port Road, Kwai Chung, N.T., Hong Kong
Phone: 852-2503-2468 Facsimile: 852-2487-5039

India

MEIDEN INDIA PVT. LTD.

507, 5th Floor, Vatika City Point, MG Road, Gurgaon-122002 Haryana, India
Phone: 91-124-4388916 Facsimile: 91-124-4388930

PRIME MEIDEN LTD.

Prime Tower, 287-288, Udyog Vihar, Phase-II, Gurgaon-122 016, India
Phone: 91-124-4111999 Facsimile: 91-124-4871698

Indonesia

P.T. MEIDEN ENGINEERING INDONESIA

20th Floor, Summitmas I, Jl. Jenderal Sudirman Kaveling 61-62 P.O.BOX 6920/KBY/Summitmas I Jakarta Selatan 12190, Indonesia
Phone: 62-21-520-0612 Facsimile: 62-21-520-0240

Korea

MEIDEN KOREA CO., LTD.

1404 DongHwa Bldg., 71, Yeouinaru-ro, Yeongdeungpo-gu, Seoul 07327, Korea
Phone: 82-2-736-0232~3 Facsimile: 82-2-736-0234

Malaysia

MEIDEN MALAYSIA SDN. BHD.

Unit A-12A-1, Level 12A, Menara UOA Bangsar 5, Jalan Bangsar Utama 1, 59000 Kuala Lumpur, Malaysia
Phone: 60-3-22878188 Facsimile: 60-3-22879188

MEIDEN METAL ENGINEERING SDN. BHD.

Lot 6, Peringkat 3, Kawasan Perindustrian Alor Gajah, 78000 Melaka, Malaysia
Phone: 60-6-556-8790 Facsimile: 60-6-556-8795

Singapore

MEIDEN ASIA PTE. LTD.

5, Jalan Pesawat, Jurong Industrial Estate, Singapore 619363
Phone: 65-6268-8222 Facsimile: 65-6264-4292

MEIDEN SINGAPORE PTE. LTD.

5, Jalan Pesawat, Jurong Industrial Estate, Singapore 619363
Phone: 65-6268-8222 Facsimile: 65-6264-4292

Thailand

THAI MEIDENSHA CO., LTD.

15th Floor, Rasa Tower II, 555 Phaholyothin Road, Chatuchak, Chatuchak, Bangkok 10900, Thailand
Phone: 66-2792-4200 Facsimile: 66-2792-4299

MEIDEN ELECTRIC (THAILAND) LTD.

898 Moo 2, Bangpa-in Industrial Estate, Udomsornayuth Rd., Klongjig, Bangpa-in, Ayudhaya 13160, Thailand
Phone: 66-35-258258 Facsimile: 66-35-221388

United Arab Emirates

MEIDEN ASIA PTE. LTD. DUBAI BRANCH

Dubai Airport Free Zone (DAFZA), 6W A-606, P.O.Box 54919, Dubai, United Arab Emirates
Phone: 971-4-214-6692 Facsimile: 971-4-214-6699

Germany

MEIDEN EUROPE GmbH.

Carl-von-Linde-Str.38, 85716 Unterschleißheim, Germany
Phone: 49-(0)89-1241-48370 Facsimile: 49-(0)89-1241-48379

TRIDELTA MEIDENSHA GmbH.

Marie-Curie-Strasse 3, D-07629, Hermsdorf, Germany
Phone: 49-36601-9328-300 Facsimile: 49-36601-9328-301

The United States

MEIDEN AMERICA, INC.

15800 Centennial Drive, Northville Township, MI 48168, U.S.A.
Phone: 1-734-656-1400 Facsimile: 1-734-459-1863